
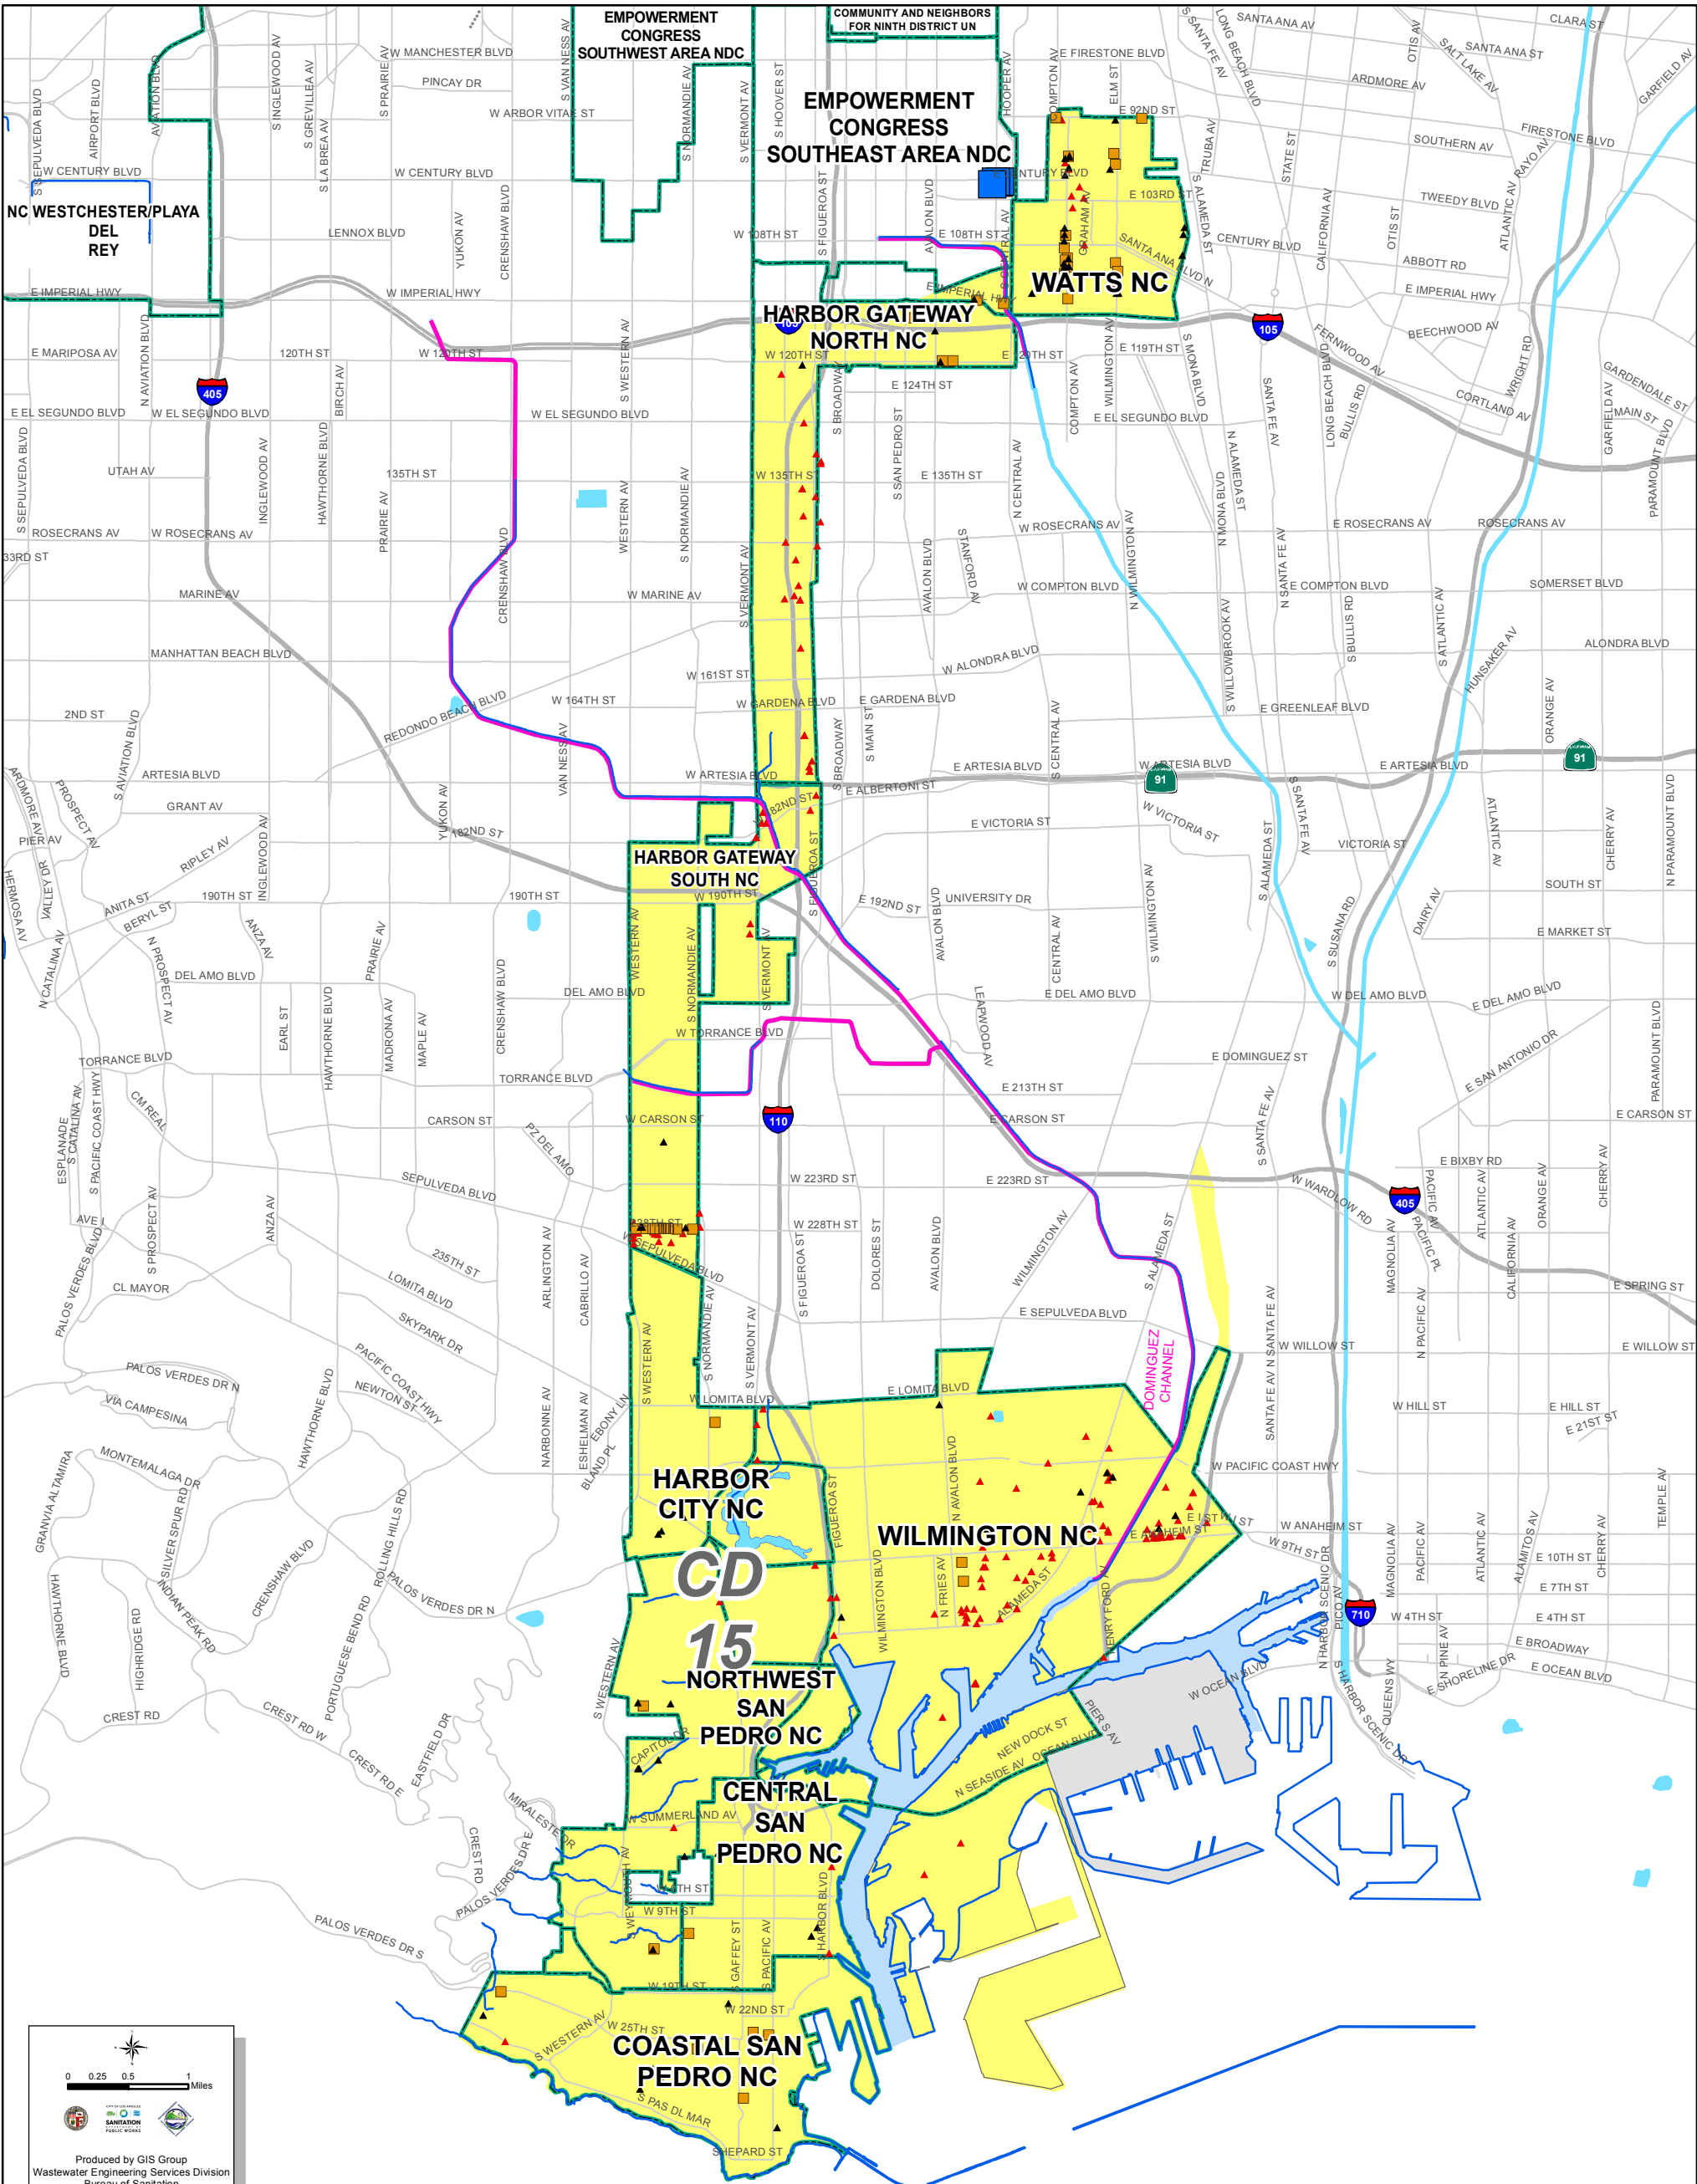


City of Los Angeles On-Site Wastewater Treatment Systems (OWTS)

Council District 15

NEIGHBORHOOD COUNCIL	RESIDENTIAL	MULTI-FAMILY	COMMERCIAL
NONE	0	2	13
CENTRAL SAN PEDRO NC	4	1	4
COASTAL SAN PEDRO NC	7	5	1
HARBOR CITY NC	4	1	0
HARBOR GATEWAY NORTH NC	4	3	22
HARBOR GATEWAY SOUTH NC	5	18	27
NORTHWEST SAN PEDRO NC	7	2	3
WATTS NC	25	15	17
WILMINGTON NC	8	2	78
TOTAL	64	49	165
600FT OF IMPAIRED WATER BODY	0	1	6
900FT OF ACTIVE WELLS	0	0	0
150FT OF STREAMS	2	0	0
5FT OF GROUNDWATER	0	0	0
BUILT BEFORE 1953	34	24	53

- ▲ Residential
- MultiFamily
- ▲ Commercial
- Active Water Wells
- Certified NCs
- Non Certified NCs
- Impaired River (303d)
- Streams (USGS 1:24,000)
- Major Roads
- Freeway
- + Council District Area
- Water Body

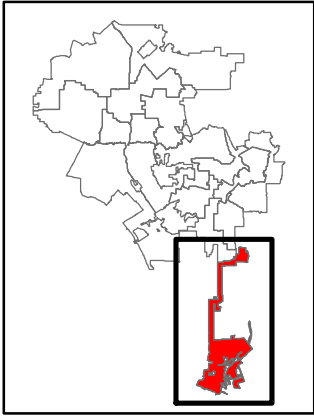

0 0.25 0.5 1 Miles

Produced by GIS Group
Wastewater Engineering Services Division
Bureau of Sanitation
Department of Public Works
City of Los Angeles
Created 9/18/2013